


TEMPORARY PAVEMENT REPAIR DETAIL

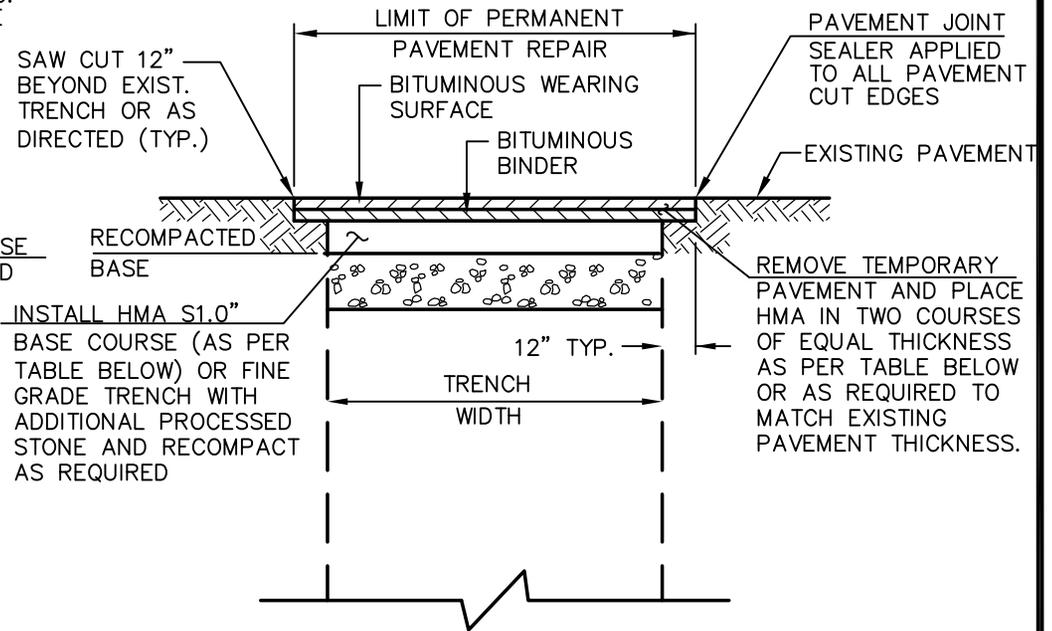

PERMANENT PAVEMENT REPAIR DETAIL

NOTES:


1. PROCESS STONE BASE SHALL BE CRUSHED TRAP ROCK CONFORMING TO ARTICLE M.05.01 OF THE FORM 817 AND TOWN SPECIFICATIONS. GRAVEL OR RECLAIMED MISCELLANEOUS AGGREGATE SHALL NOT BE USED.
2. PERMANENT TRENCH REPAIRS FOR STREETS WITH CONCRETE PAVEMENT OR CONCRETE BASE MAY CONSIST OF 2" HMA S0.5", 6" HMA S1.0", AND 10" GRAVEL SUBBASE AT THE DISCRETION OF THE TOWN ENGINEER.
3. AT THE REQUEST OF THE TOWN ENGINEER THE CONTRACTOR SHALL VERIFY AND SUBMIT PROPER TESTING RESULTS THAT COMPACTION MEETS WITH TOWN'S STANDARDS FOR A 95% COMPACTED DENSITY.

	LOCAL OR COLLECTOR	ARTERIAL (> 3000 ADT)
--	--------------------	-----------------------

HMA S0.375"	1.5"	N/A
HMA S0.5"	2"	3" (IN TWO LIFTS)
HMA S1.0"	N/A	6" (IN TWO LIFTS)

SCALE : NONE  
 DRAWN BY: SR  
 CHECKED BY: SMB  
 APPROVED BY: DAP

LAST REVISED:  
 3/28/2017



TOWN OF GLASTONBURY  
 DEPARTMENT OF PHYSICAL SERVICES  
 ENGINEERING DIVISION

TEMPORARY AND  
 PERMANENT PAVEMENT  
 REPAIRS

